







**LEGENDS:**


-  MOTION DETECTOR
-  POE SWITCH IN NETWORK CABINET
-  360° CEILING MOUNTED CCTV
-  CAT5 CABLE
-  WIFI ACCESS POINT DEVICE

**NOTES:**

1. NORMALLY CCTV CAMERAS CAN SEE FROM 40 FEET TO 120 FEET DEPENDING ON VARIOUS FACTORS.
2. MOST CAMERAS WITH INFRARED TECHNOLOGY CAN SEE BETWEEN 30 AND 40 FEET AT NIGHT. HIGH-END CAMERAS THAT USE ADVANCED SENSOR TECHNOLOGY CAN SEE UP TO 170 FEET.

THIRD FLOOR  
**CCTV CONNECTION PLAN**  
 SCALE 1 : 100 M.

|   |   |   |  |   |  |   |  |                           |           |
|---|---|---|--|---|--|---|--|---------------------------|-----------|
|  | <b>SOUTHERN LEYTE UNIVERSITY</b><br>SOGOD, SOUTHERN LEYTE<br>www.slsuonline.edu.ph<br>email: slsmaincampus@gmail.com<br>telefax: (053) 517-8299 | PREPARED BY :<br>JEAMES PAUL V. EVANGELISTA<br>REG. ARCHITECT | REVIEWED BY :<br>RYAN A. MACUTO<br>REG. CIVIL ENGINEER | PROJECT :<br><b>PROPOSED COMPLETION OF LIVELIHOOD TRAINING AND DEVELOPMENT CENTER (PHASE 4)</b> | OWNER :<br>SOUTHERN LEYTE STATE UNIVERSITY | APPROVED AS PER PLAN :<br>JUDE A. DUARTE, DPA<br>UNIVERSITY PRESIDENT | SHEET CONTENT<br>AS SHOWN                    | SHEET NO.<br>EE-01        |           |
|   | LOCATION: SLSU-MAIN CAMPUS, SAN ROQUE, SOGOD SOUTHERN LEYTE   |   |  |   | ADDRESS: SOGOD, SOUTHERN LEYTE             |   | CHECKED :<br>DRAWN :<br>APPROVED :<br>DATE : | SCALE<br>AS SHOWN @ 20x30 | PROJ. NO. |
|   |   |   |  |   |  |   |  |                           |           |

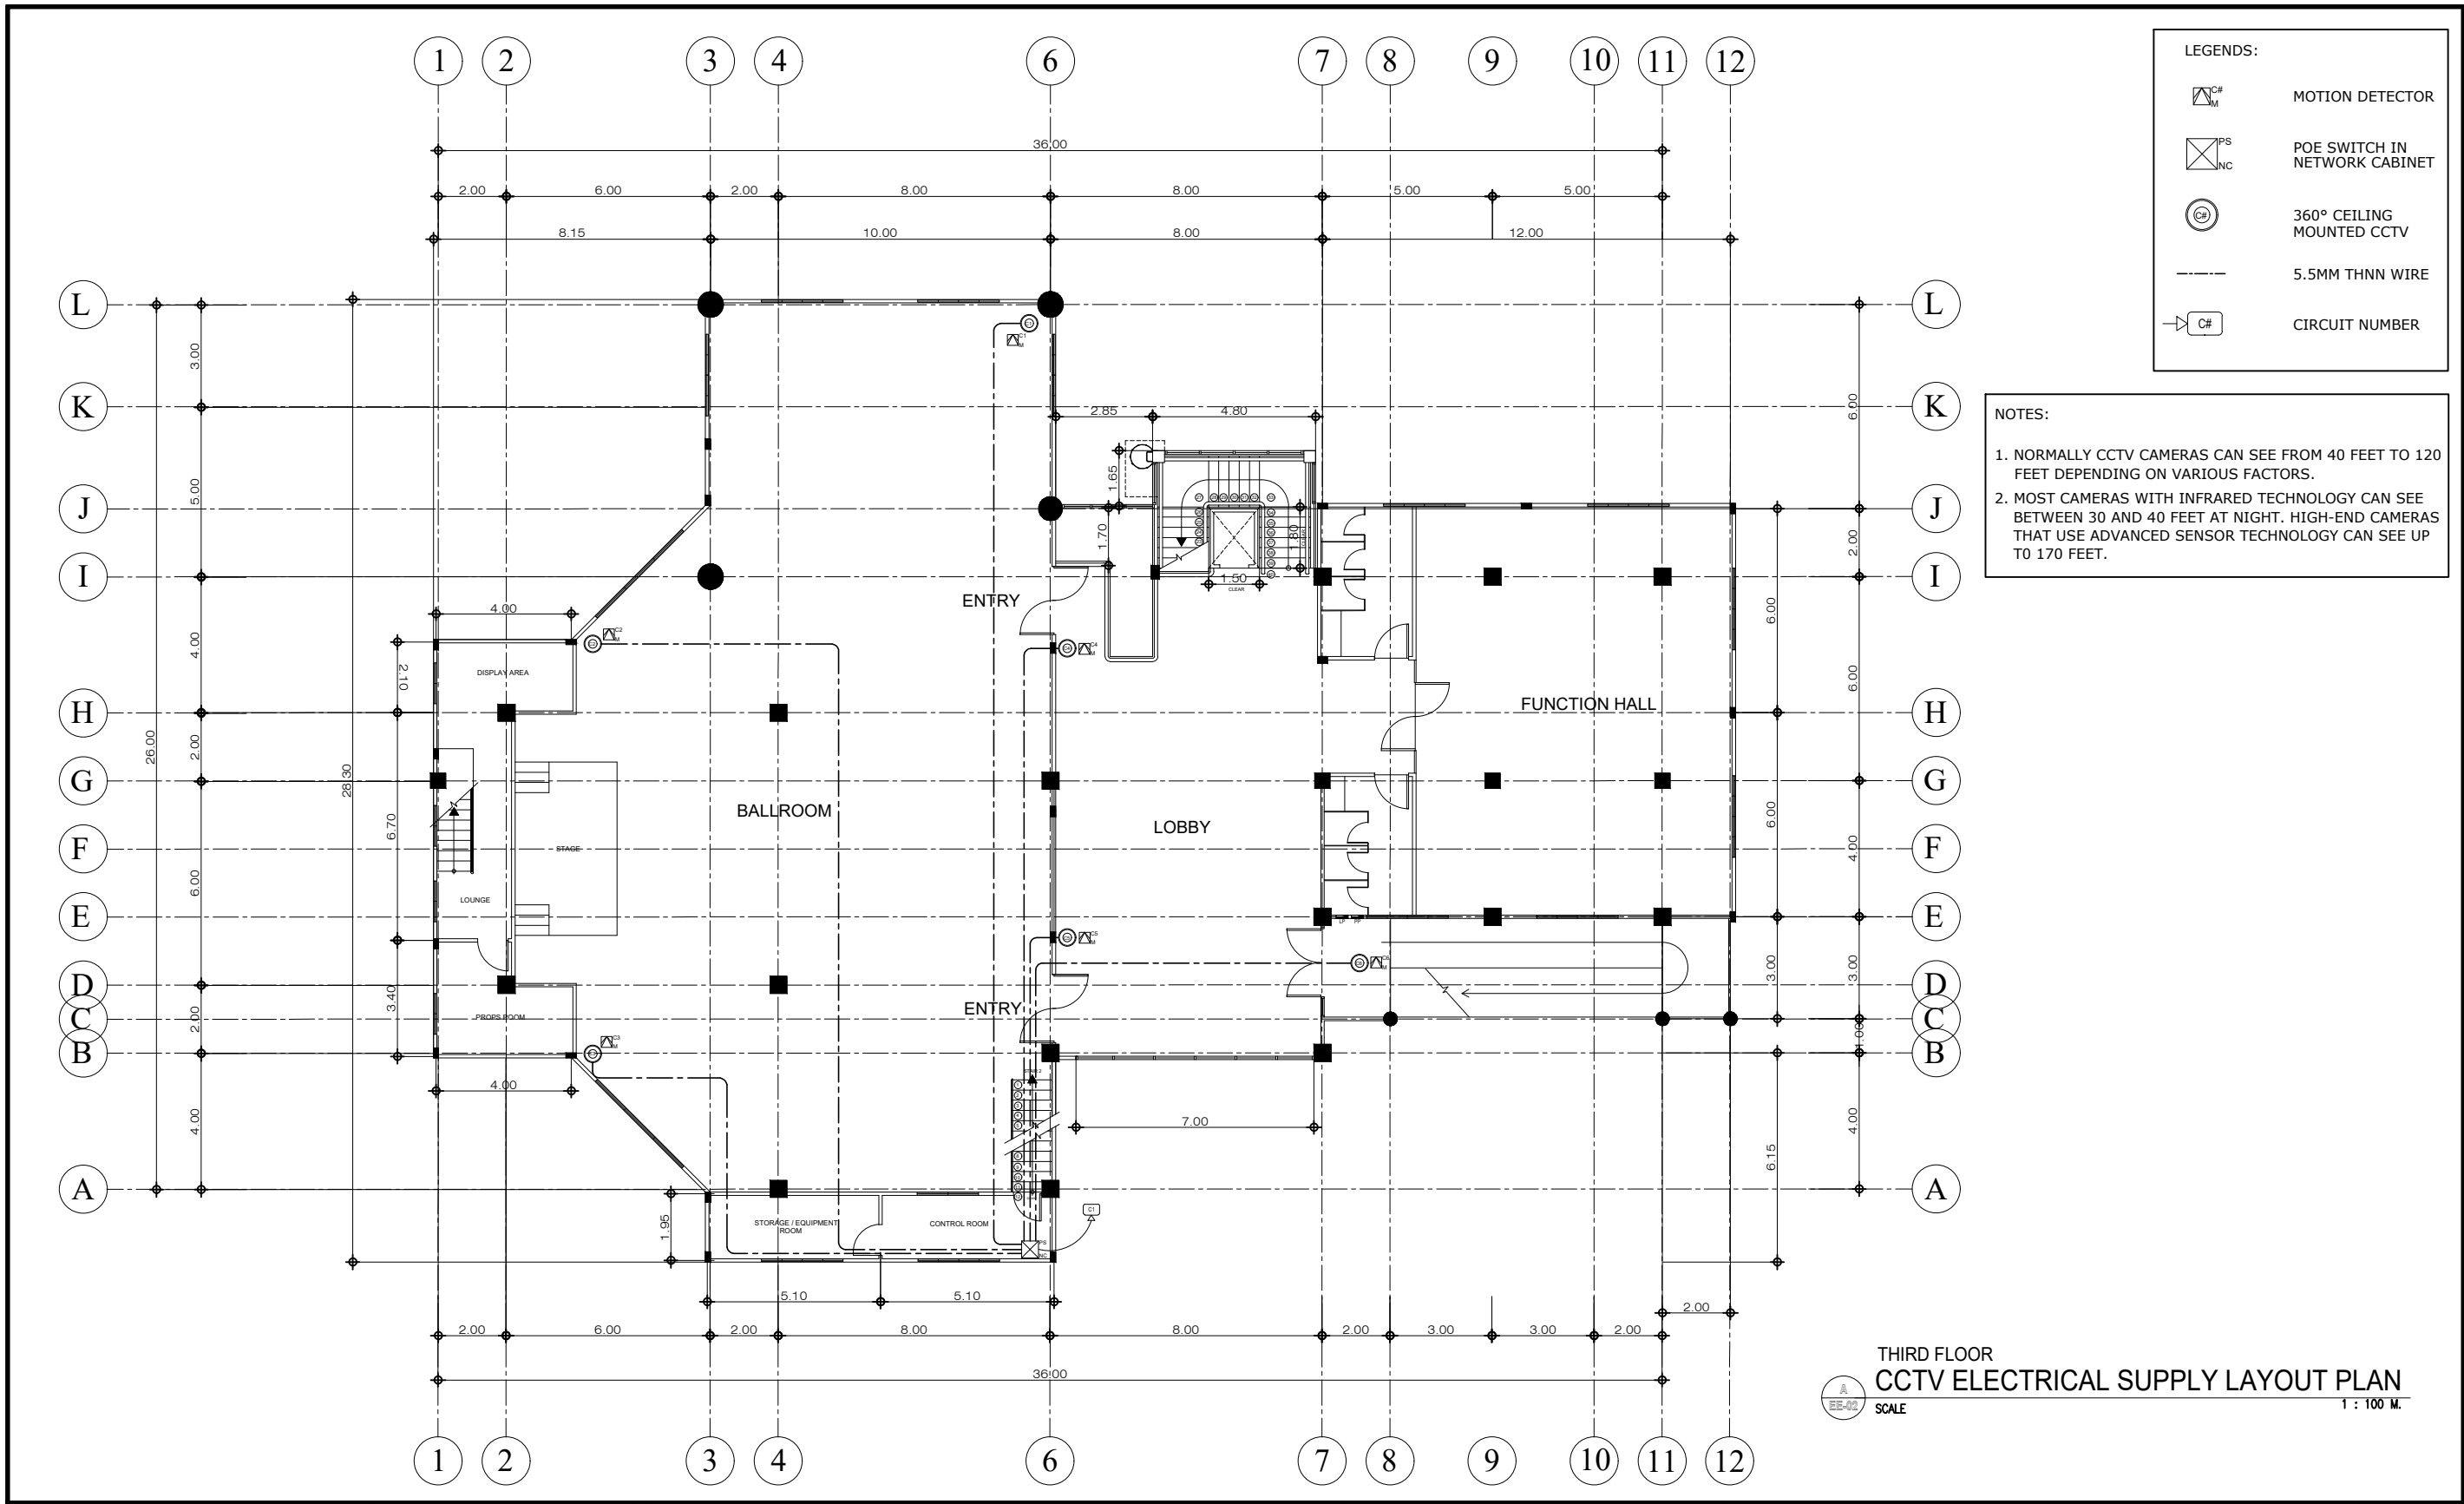

**LEGENDS:**


- MOTION DETECTOR
- POE SWITCH IN NETWORK CABINET
- 360° CEILING MOUNTED CCTV
- 5.5MM THNN WIRE
- CIRCUIT NUMBER

**NOTES:**





1. NORMALLY CCTV CAMERAS CAN SEE FROM 40 FEET TO 120 FEET DEPENDING ON VARIOUS FACTORS.
2. MOST CAMERAS WITH INFRARED TECHNOLOGY CAN SEE BETWEEN 30 AND 40 FEET AT NIGHT. HIGH-END CAMERAS THAT USE ADVANCED SENSOR TECHNOLOGY CAN SEE UP TO 170 FEET.

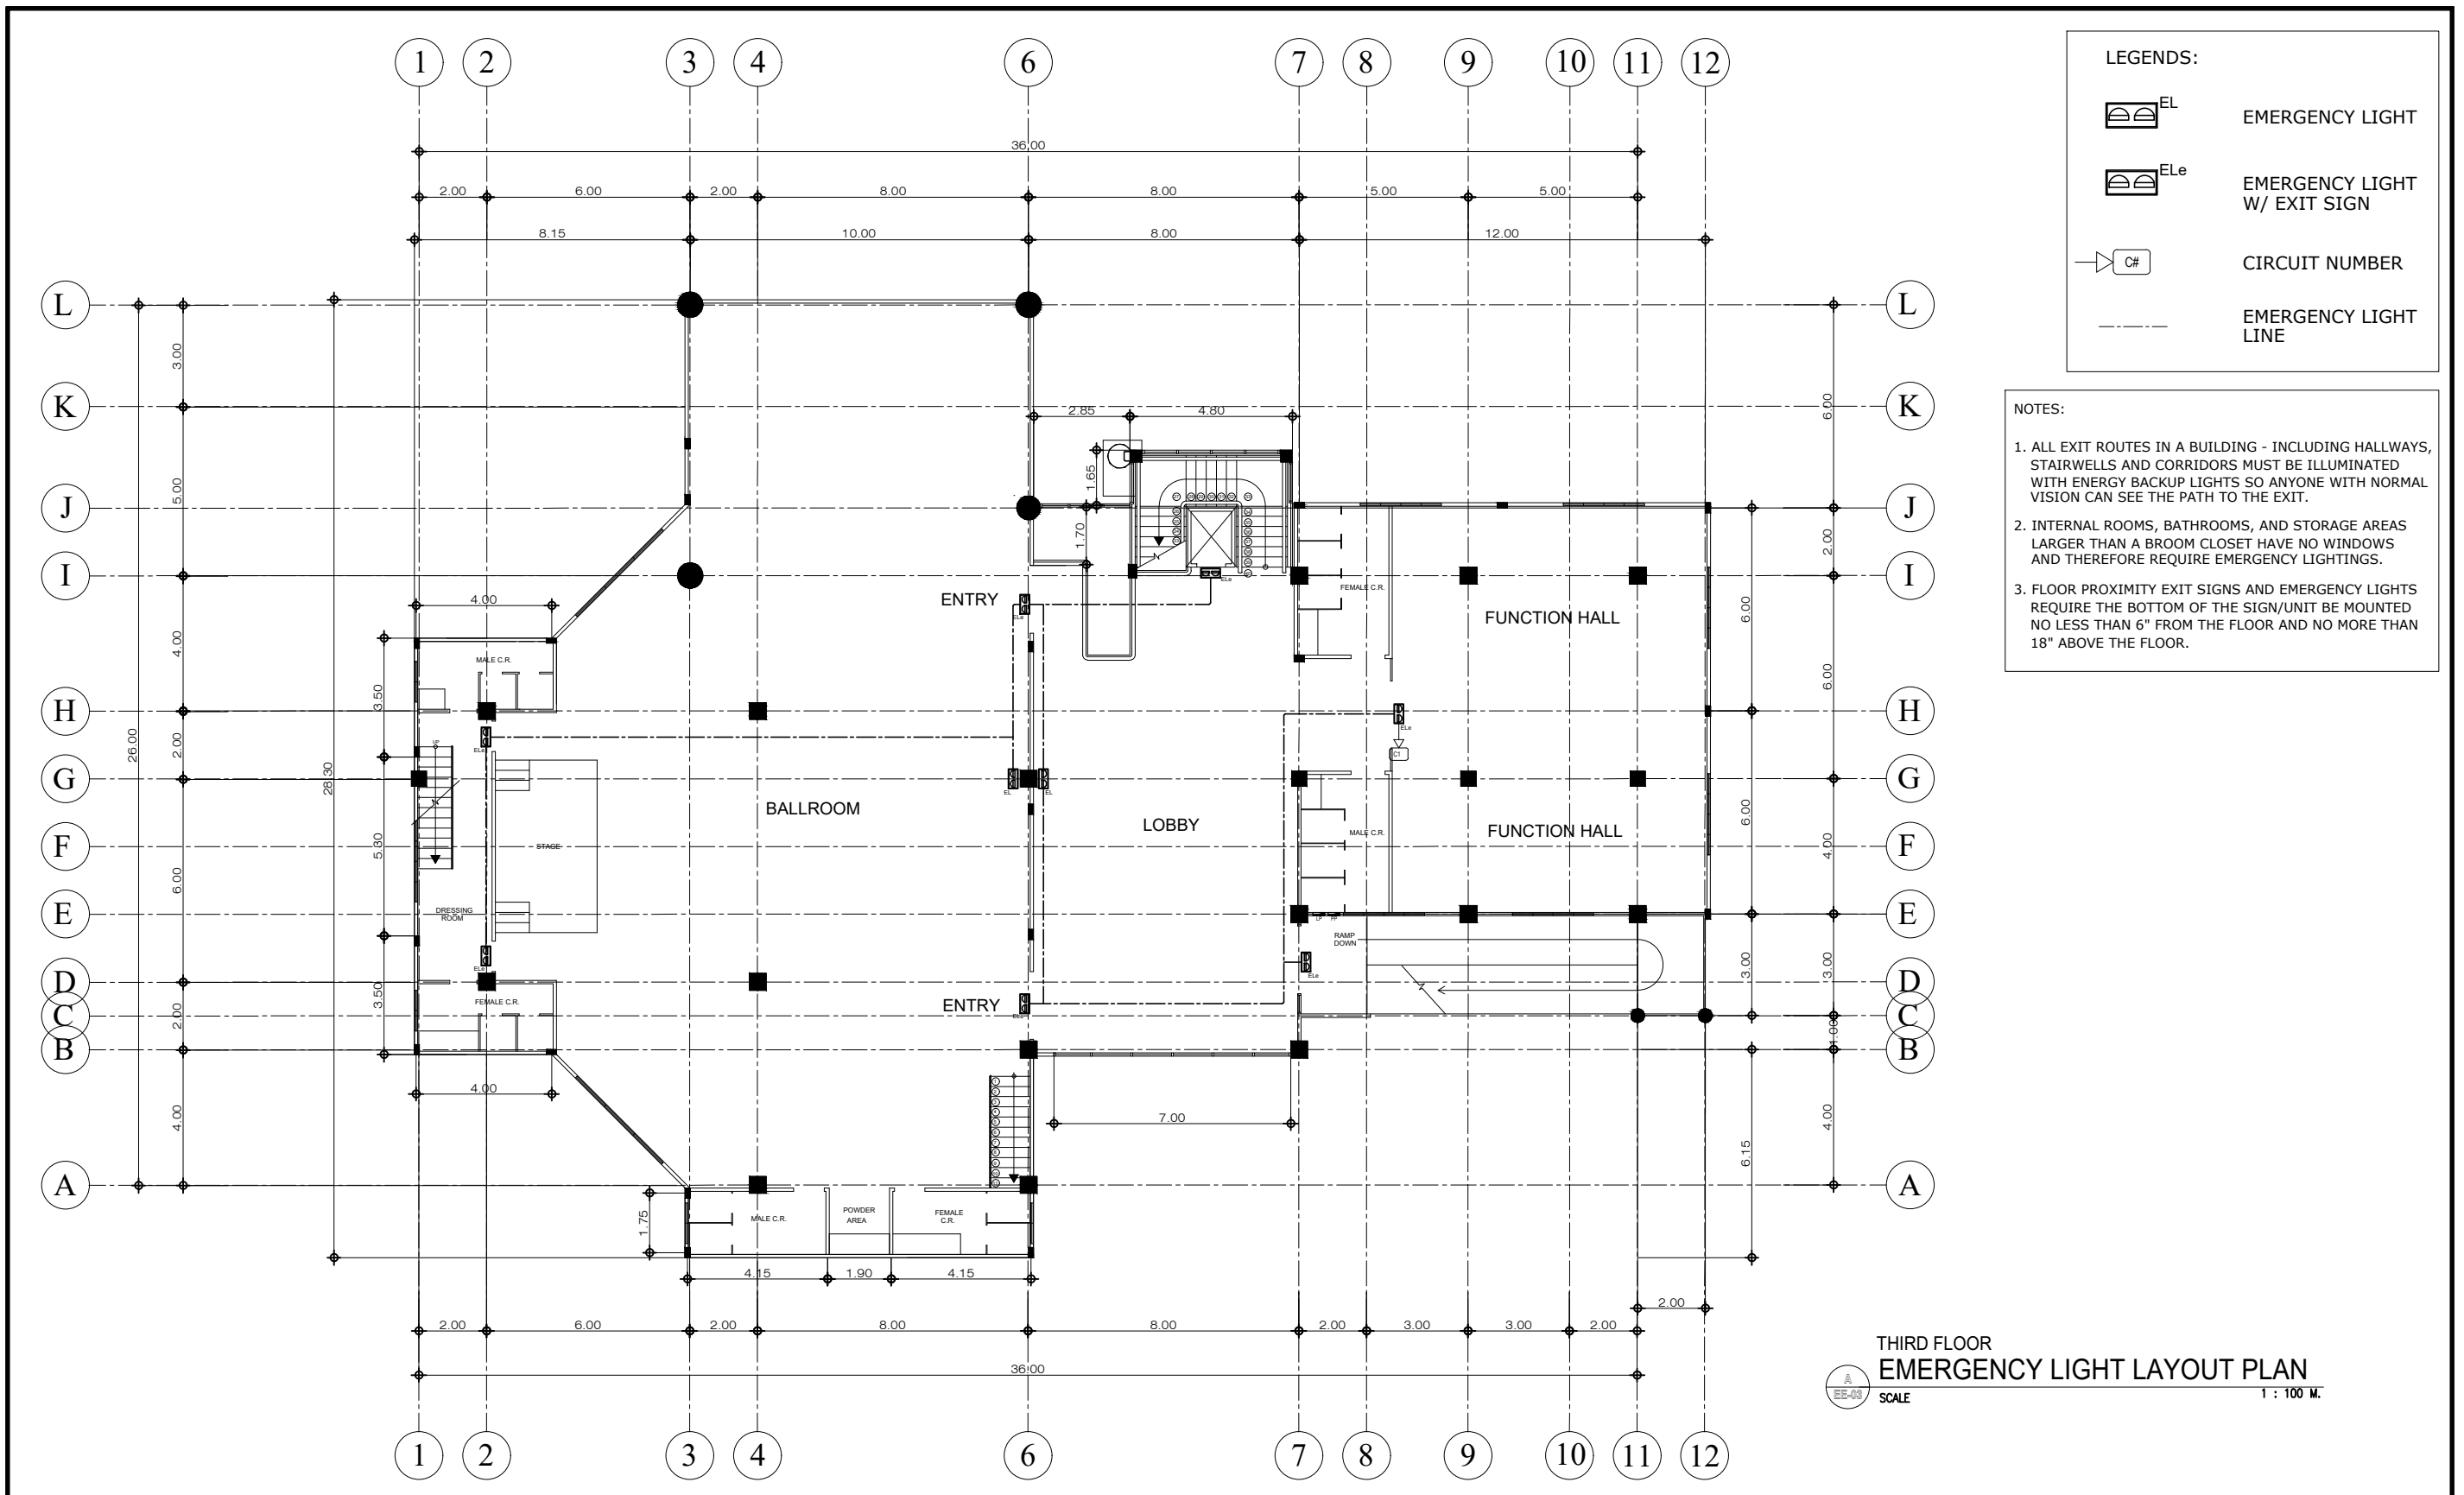**THIRD FLOOR  
CCTV ELECTRICAL SUPPLY LAYOUT PLAN**  
 SCALE 1 : 100 M.

|  |  |   |  |   |   |   |                                  |                           |                           |
|--|--|---|--|---|---|---|----------------------------------|---------------------------|---------------------------|
|  | <b>SOUTHERN LEYTE STATE UNIVERSITY</b><br>SOGOD, SOUTHERN LEYTE<br><small>www.slsuonline.edu.ph<br/>         email: slsmaincampus@gmail.com<br/>         telefax: (053) 517-8299</small> | PREPARED BY :<br><u>JEAMES PAUL V. EVANGELISTA</u><br><small>REG. ARCHITECT</small> | REVIEWED BY :<br><u>RYAN A. MACUTO</u><br><small>REG. CIVIL ENGINEER</small> | PROJECT :<br><b>PROPOSED COMPLETION OF LIVELIHOOD TRAINING AND DEVELOPMENT CENTER (PHASE 4)</b> | OWNER :<br><b>SOUTHERN LEYTE STATE UNIVERSITY</b> | APPROVED AS PER PLAN :<br><u>JUDE A. DUARTE, DPA</u><br><small>UNIVERSITY PRESIDENT</small> | SHEET CONTENT<br><b>AS SHOWN</b> | SHEET NO.<br><b>EE-02</b> |                           |
|  | LOCATION: SLSU-MAIN CAMPUS, SAN ROQUE, SOGOD SOUTHERN LEYTE  |   |  |   | ADDRESS: SOGOD, SOUTHERN LEYTE                    |   | CHECKED :<br>APPROVED :          | DRAWN :<br>DATE :         | SCALE<br>AS SHOWN @ 20x30 |




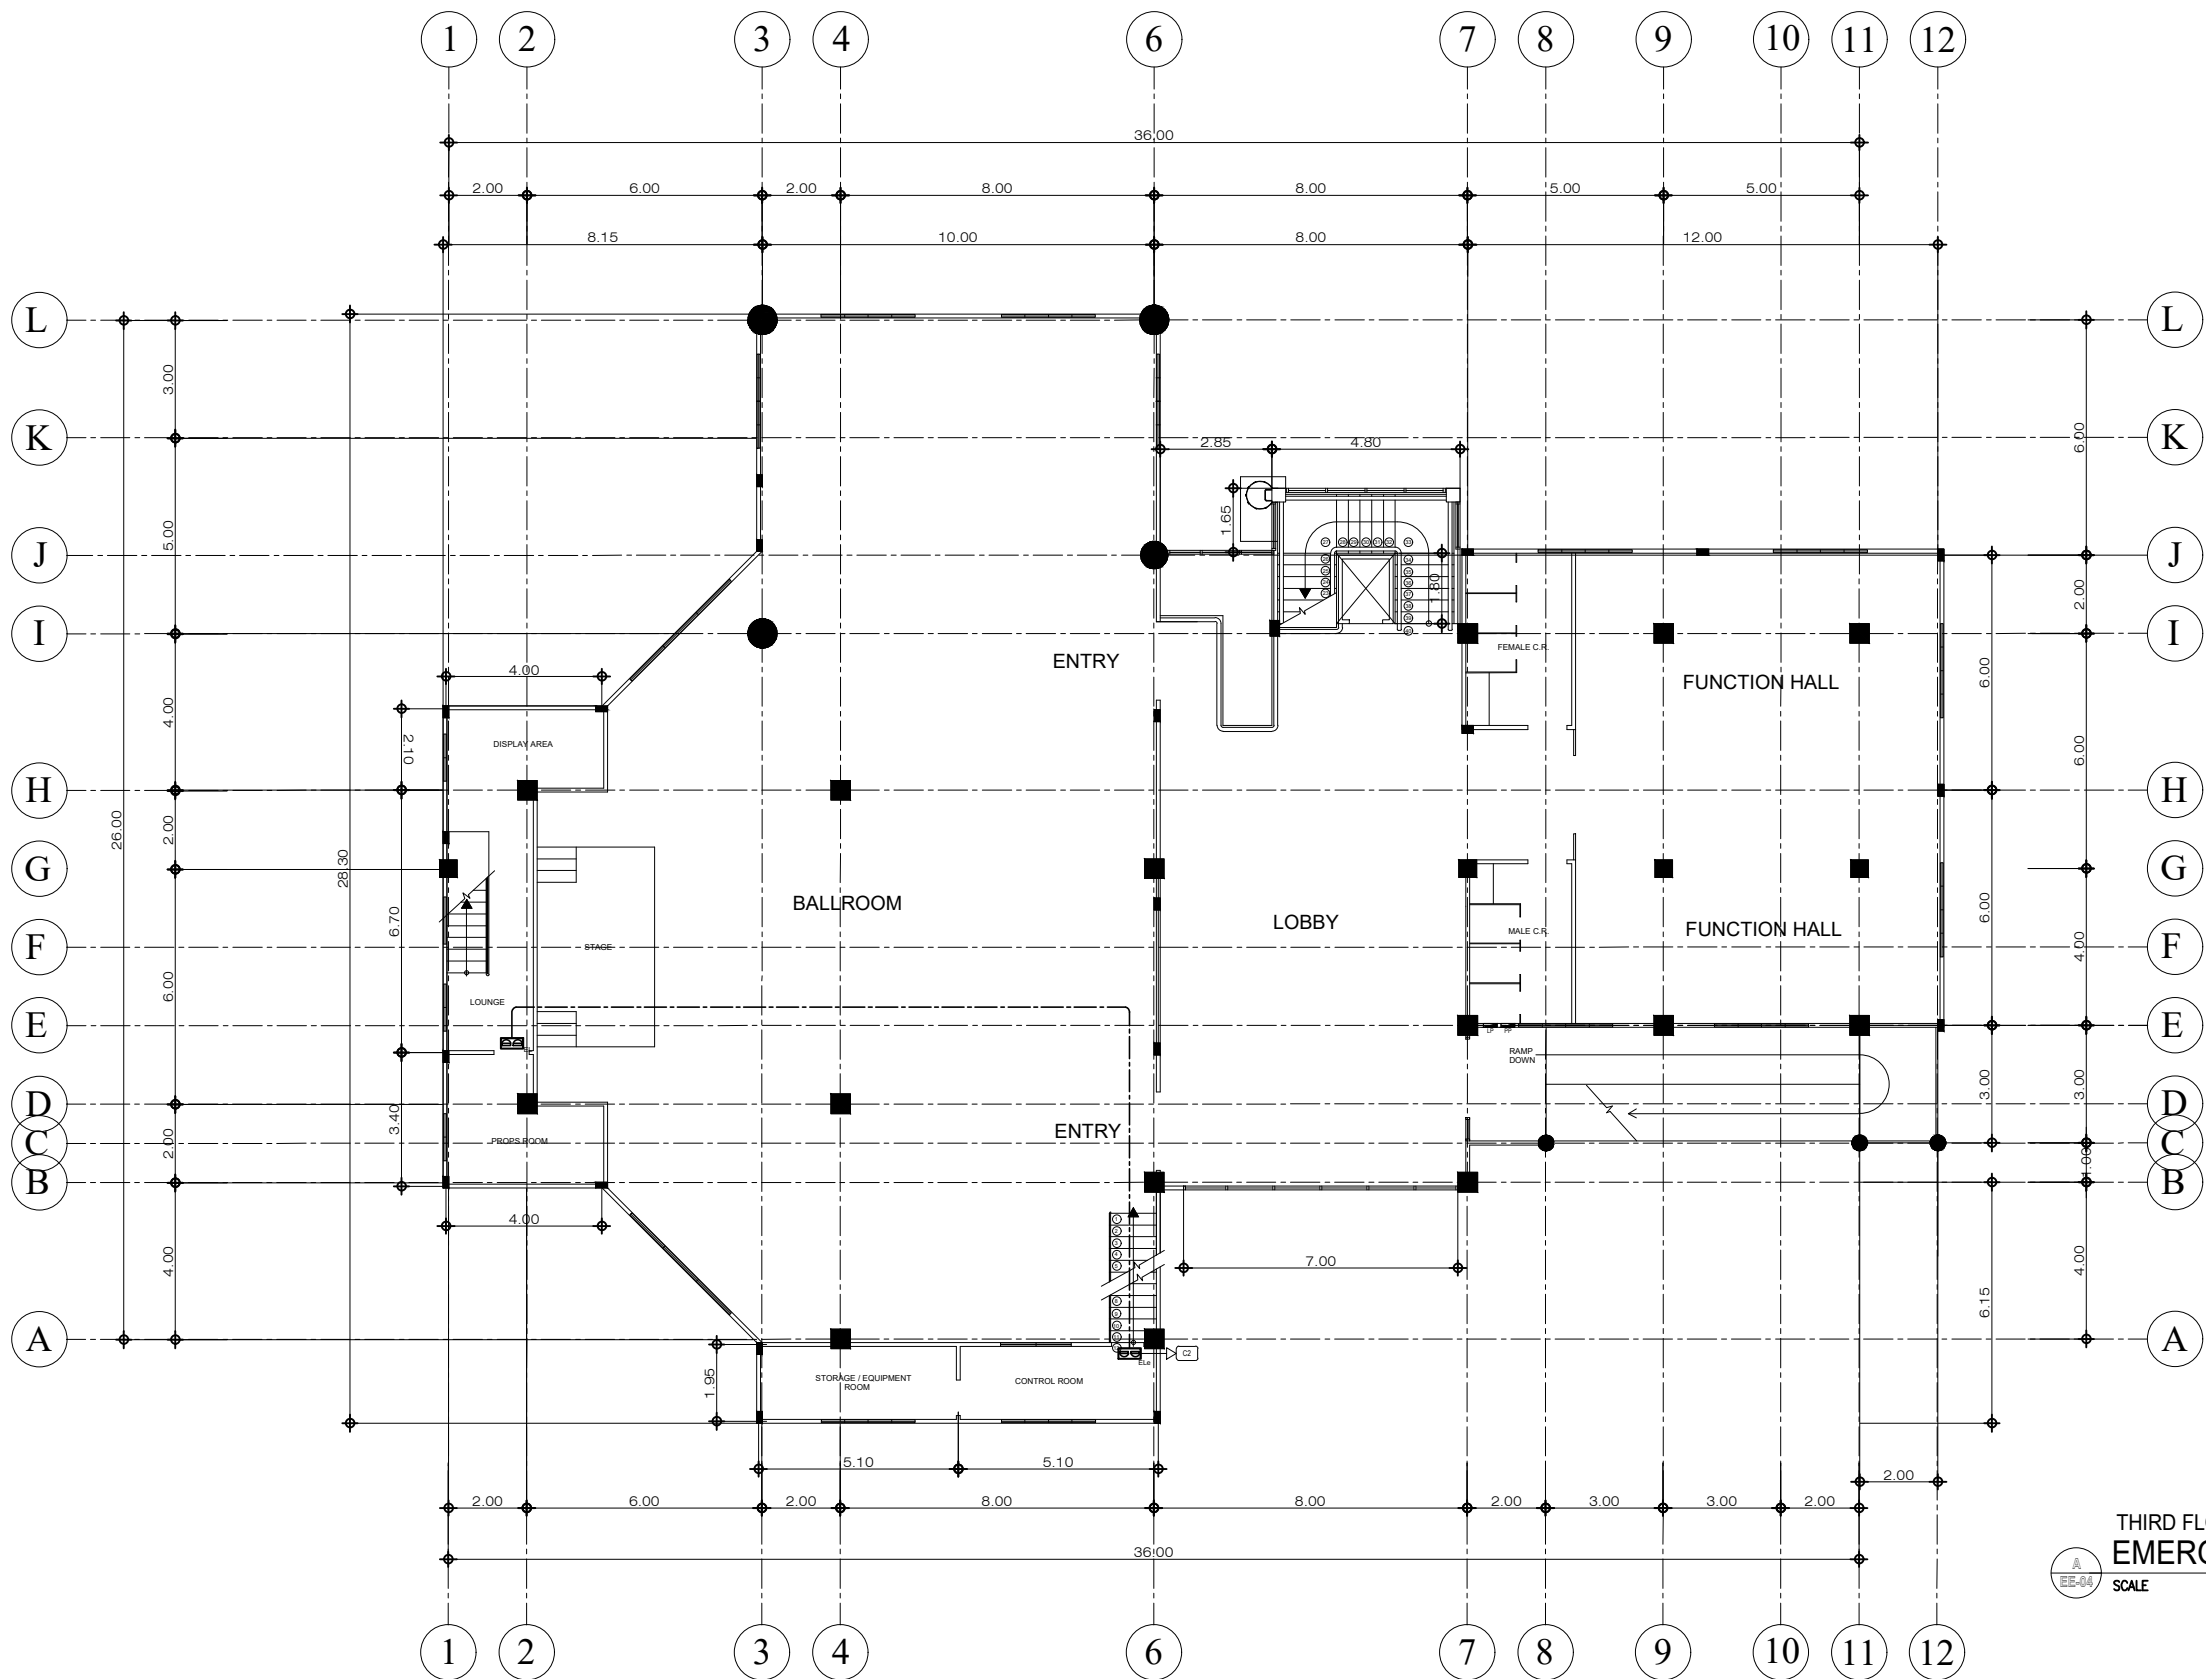
**LEGENDS:**

-  EL EMERGENCY LIGHT
-  EL<sub>e</sub> EMERGENCY LIGHT W/ EXIT SIGN
-  C# CIRCUIT NUMBER
-  EMERGENCY LIGHT LINE

- NOTES:**
1. ALL EXIT ROUTES IN A BUILDING - INCLUDING HALLWAYS, STAIRWELLS AND CORRIDORS MUST BE ILLUMINATED WITH ENERGY BACKUP LIGHTS SO ANYONE WITH NORMAL VISION CAN SEE THE PATH TO THE EXIT.
  2. INTERNAL ROOMS, BATHROOMS, AND STORAGE AREAS LARGER THAN A BROOM CLOSET HAVE NO WINDOWS AND THEREFORE REQUIRE EMERGENCY LIGHTINGS.
  3. FLOOR PROXIMITY EXIT SIGNS AND EMERGENCY LIGHTS REQUIRE THE BOTTOM OF THE SIGN/UNIT BE MOUNTED NO LESS THAN 6" FROM THE FLOOR AND NO MORE THAN 18" ABOVE THE FLOOR.

THIRD FLOOR  
**EMERGENCY LIGHT LAYOUT PLAN**  
 SCALE 1 : 100 M.

|   |   |   |  |  |  |   |   |                    |           |
|---|---|---|--|--|--|---|---|--------------------|-----------|
|  | <b>SOUTHERN LEYTE UNIVERSITY</b><br>SOGOD, SOUTHERN LEYTE<br>www.slsuonline.edu.ph<br>email: slsmaincampus@gmail.com<br>telefax: (053) 517-8299 | PREPARED BY:<br><u>JEAMES PAUL V. EVANGELISTA</u><br>REG. ARCHITECT | REVIEWED BY:<br><u>RYAN A. MACUTO</u><br>REG. CIVIL ENGINEER | PROJECT:<br><b>PROPOSED COMPLETION OF LIVELIHOOD TRAINING AND DEVELOPMENT CENTER (PHASE 4)</b> | OWNER:<br><b>SOUTHERN LEYTE STATE UNIVERSITY</b> | APPROVED AS PER PLAN:<br><u>JUDE A. DUARTE, DPA</u><br>UNIVERSITY PRESIDENT | SHEET CONTENT<br>AS SHOWN                           | SHEET NO.<br>EE-03 |           |
|   | LOCATION: SLSU-MAIN CAMPUS, SAN ROQUE, SOGOD SOUTHERN LEYTE   |   |  |  | ADDRESS: SOGOD, SOUTHERN LEYTE                   |   | CHECKED: _____ DRAWN: _____ SCALE: AS SHOWN @ 20x30 |                    | PROJ. NO. |
|   |   |   |  |  |  |   | APPROVED: _____ DATE: _____                         |                    |           |



**LEGENDS:**

- EMERGENCY LIGHT
- EMERGENCY LIGHT W/ EXIT SIGN
- CIRCUIT NUMBER
- EMERGENCY LIGHT LINE

- NOTES:**
1. ALL EXIT ROUTES IN A BUILDING - INCLUDING HALLWAYS, STAIRWELLS AND CORRIDORS MUST BE ILLUMINATED WITH ENERGY BACKUP LIGHTS SO ANYONE WITH NORMAL VISION CAN SEE THE PATH TO THE EXIT.
  2. INTERNAL ROOMS, BATHROOMS, AND STORAGE AREAS LARGER THAN A BROOM CLOSET HAVE NO WINDOWS AND THEREFORE REQUIRE EMERGENCY LIGHTINGS.
  3. FLOOR PROXIMITY EXIT SIGNS AND EMERGENCY LIGHTS REQUIRE THE BOTTOM OF THE SIGN/UNIT BE MOUNTED NO LESS THAN 6" FROM THE FLOOR AND NO MORE THAN 18" ABOVE THE FLOOR.

THIRD FLOOR (LOFT)  
**EMERGENCY LIGHT LAYOUT PLAN**  
 SCALE 1 : 100 M.

|  |   |  |   |  |   |  |                           |           |
|--|---|--|---|--|---|--|---------------------------|-----------|
| <p><b>SOUTHERN LEYTE STATE UNIVERSITY</b><br/>         SOGOD, SOUTHERN LEYTE<br/>         www.slsuonline.edu.ph<br/>         email: slsmaincampus@gmail.com<br/>         telefax: (053) 517-8299</p> | PREPARED BY :<br>JEAMES PAUL V. EVANGELISTA<br>REG. ARCHITECT | REVIEWED BY :<br>RYAN A. MACUTO<br>REG. CIVIL ENGINEER | PROJECT :<br><b>PROPOSED COMPLETION OF LIVELIHOOD TRAINING AND DEVELOPMENT CENTER (PHASE 4)</b> | OWNER :<br>SOUTHERN LEYTE STATE UNIVERSITY | APPROVED AS PER PLAN :<br>JUDE A. DUARTE, DPA<br>UNIVERSITY PRESIDENT | SHEET CONTENT<br>AS SHOWN                    | SHEET NO.<br>EE-04        |           |
|  | LOCATION: SLSU-MAIN CAMPUS, SAN ROQUE, SOGOD SOUTHERN LEYTE   |  |   | ADDRESS: SOGOD, SOUTHERN LEYTE             |   | CHECKED :<br>DRAWN :<br>APPROVED :<br>DATE : | SCALE<br>AS SHOWN @ 20x30 | PROJ. NO. |
|  | SLSU-MAIN CAMPUS, SAN ROQUE, SOGOD SOUTHERN LEYTE             |  |   |  |   |  |                           |           |